



**INSTITUTO DE CIENCIAS  
DE LA CONSTRUCCIÓN  
EDUARDO TORROJA**

C/ Serrano Galvache n. 4 28033 Madrid (Spain)  
Tel.: (34) 91 302 04 40 Fax: (34) 91 302 07 00  
[direccion.ietcc@csic.es](mailto:direccion.ietcc@csic.es) <https://dit.ietcc.csic.es>

## European Technical Assessment

**ETA 19/0340  
of 3/07/2019**

English translation prepared by IETcc. Original version in Spanish language

### General Part

**Technical Assessment Body issuing the ETA designated according to Art. 29 of Regulation (EU) 305/2011**

Instituto de Ciencias de la Construcción Eduardo Torroja (IETcc)

**Trade name of the construction product**

**ADBS concrete screw**

**Product family to which the construction product belongs**

Concrete screw of sizes 7.5, 10.5, 12.5 and 16.5 for use in cracked and non-cracked concrete.

**Manufacturer**

**Allfa Dübel GmbH.**  
Braukämperstrasse 101  
D-45899 Gelsenkirchen

**Manufacturing plants**

**Plant n.1**

**This European Technical Assessment contains**

15 pages including 4 annexes which form an integral part of this assessment.

**This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of**

European Technical Assessment EAD 330232-00-0601 "Mechanical Fasteners for use in concrete", ed. October 2016

**This version replaces**

-

*English translation prepared by IETcc*

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission according to article 25 (3) of Regulation (EU) No 305/2011.

English translation prepared by IETcc

## SPECIFIC PART

### 1. Technical description of the product

The anchor ADBS concrete screw is an anchor made of carbon steel. The anchor is made in sizes 7.5, 10.5, 12.5 and 16.5, and is screwed into a predrilled cylindrical drill hole. The special thread of the anchor cuts an internal thread into the member while setting. The anchorage is characterised by mechanical interlock in the special thread.

Product and product description is given in annex A.

### 2. Specification of the intended use in accordance with the applicable European Assessment Document.

The performances given in section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means to choosing the right products in relation to the expected economically reasonable working life of the works.

### 3. Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic   | Performance |
|--|-------------|
| ADBS concrete screw performance for static or quasi static actions | See annex C |

#### 3.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance                                 |
|--------------------------|---|
| Reaction to fire         | Anchorage satisfy requirements for class A1 |
| Resistance to fire       | See annex D                                 |

### 4. Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

The applicable European legal act for the system of Assessment and Verification of Constancy of Performances (see annex V of Regulation (EU) No 305/2011) is 96/582/EC.

The system to be applied is 1.

English translation prepared by IETcc

**5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document.**

The technical details necessary for the implementation of the AVCP system are laid down in the quality plan deposited at Instituto de Ciencias de la Construcción Eduardo Torroja.



Instituto de Ciencias de la Construcción Eduardo Torroja  
CONSEJO SUPERIOR DE INVESTIGACIONES CIENTÍFICAS

C/ Serrano Galvache n.º 4. 28033 Madrid.  
Tel: (+34) 91 302 04 40 Fax: (+34) 91 302 07 00

<https://dit.ietcc.csic.es>



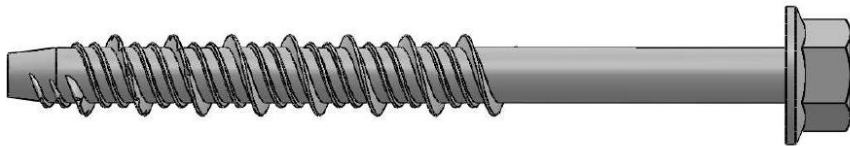

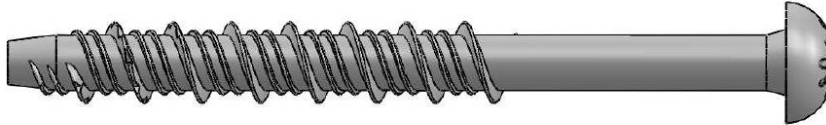

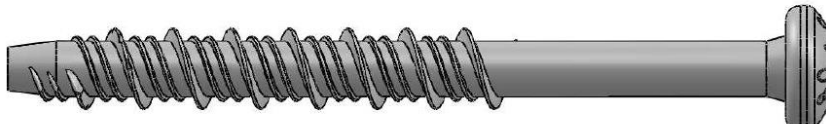

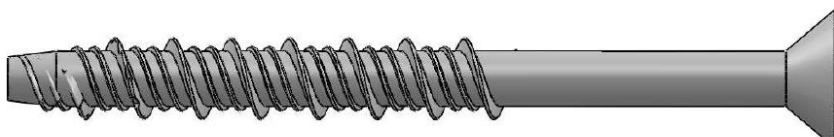

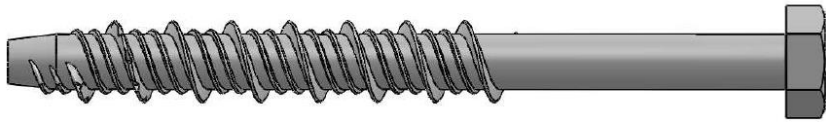

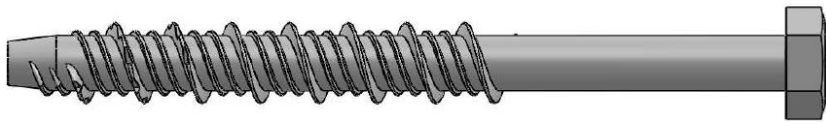

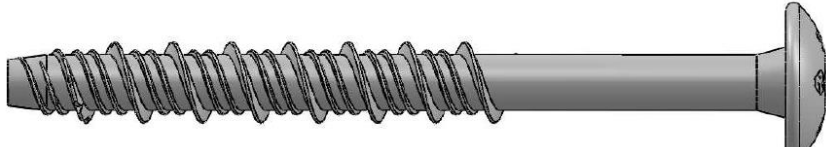

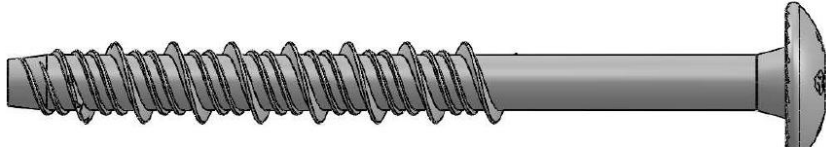

On behalf of the Instituto de Ciencias de la Construcción Eduardo Torroja  
Madrid, 3<sup>rd</sup> of July 2019



Director IETcc-CSIC

English translation prepared by IETcc

**Product and identification**

|   |   |     |
|---|---|-----|
|   |    | SSW |
|    |    | SSR |
|    |    | SSP |
|   |   | SSK |
|  |  | SSH |
|  |  | SSX |
|  |  | SST |
|  |  | SSN |



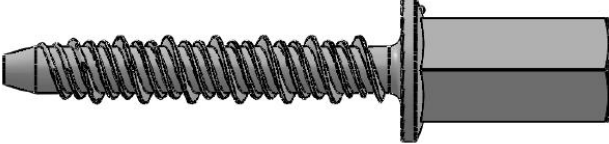

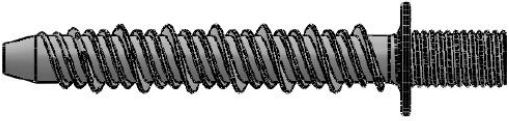





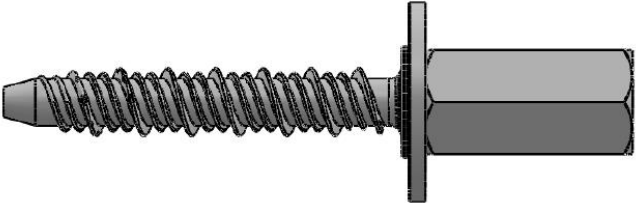

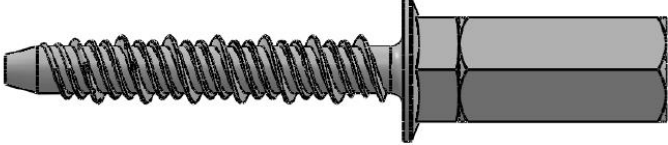

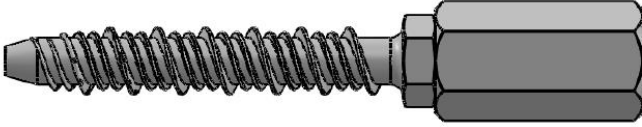

**ADBS concrete screw**

**Product description**

Identification

**Annex A1**

English translation prepared by IETcc

|   |   |     |
|---|---|-----|
|    |    | SSD |
|    |    | SSI |
|    |    | SSF |
|    |    | SSO |
|  |  | SSU |
|  |   | SSG |
|  |  | SSQ |
|  |  | SSV |

|                            |                 |
|----------------------------|-----------------|
| <b>ADBS concrete screw</b> | <b>Annex A2</b> |
| <b>Product description</b> |                 |
| Identification             |                 |

English translation prepared by IETcc

Marking/Identification on anchor:

- Company logo
- Outer diameter
- Length
- Anchor type:
  - Hex head with washer SSW
  - Round head SSR
  - Pan head SSP
  - Countersunk head SSK
  - Hex head SSH
  - Hex head, hexalobular recess SSX
  - Truss head SST
  - Truss head with underhead ribs SSN
  - Connection thread with hexagon drive SSD
  - Internal thread SSI
  - Flat washer head with connection thread SSF
  - Hex washer head with connection thread SSO
  - Hex head with connection thread SSU
  - SSF flex with coupler nut SSG
  - SSO flex with coupler nut SSQ
  - SSU flex with coupler nut SSV

**Table A1: Materials**

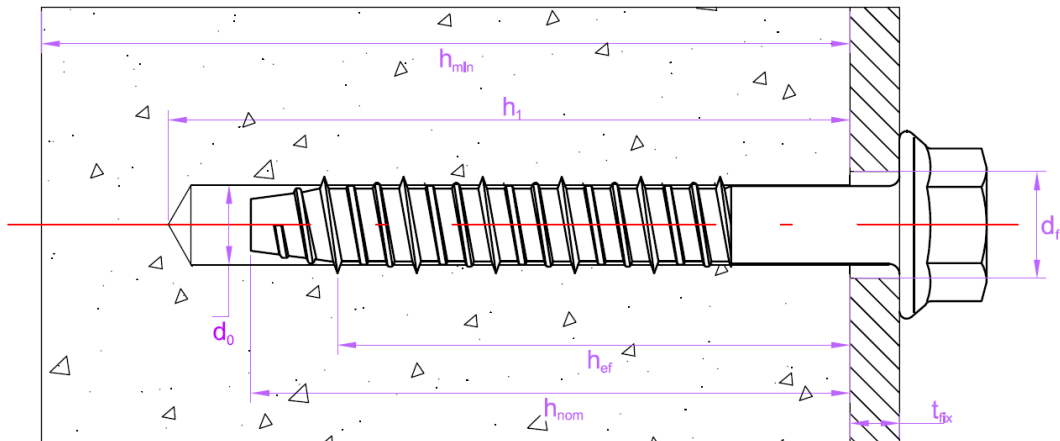
| Item | Designation | ADBS concrete screw  |
|------|-------------|--|
| 1    | Anchor Body | Carbon steel wire rod cold forged. Allowed coatings: <ul style="list-style-type: none"> <li>• Zinc plated ISO 4042</li> <li>• Silver ruspert</li> <li>• Zinc flake EN 10683</li> </ul> |

|                            |                 |
|----------------------------|-----------------|
| <b>ADBS concrete screw</b> | <b>Annex A3</b> |
| <b>Product description</b> |                 |
| Identification             |                 |

English translation prepared by IETcc

### Installed condition

- $h_{ef}$ : Effective anchorage depth
- $h_1$ : Depth of drilled hole
- $h_{nom}$ : Overall anchor embedment depth in the concrete
- $h_{min}$ : Minimum thickness of concrete member
- $t_{fix}$ : Thickness of fixture
- $d_0$ : Nominal diameter of drill bit
- $d_f$ : Diameter of clearance hole in fixture




**Drawing A1.** Installed condition for anchors SSW, SSR, SSP, SSK, SSH, SSX, SST and SSN.


|                            |                 |
|----------------------------|-----------------|
| <b>ADBS concrete screw</b> | <b>Annex A4</b> |
| <b>Product description</b> |                 |
| Installed condition        |                 |



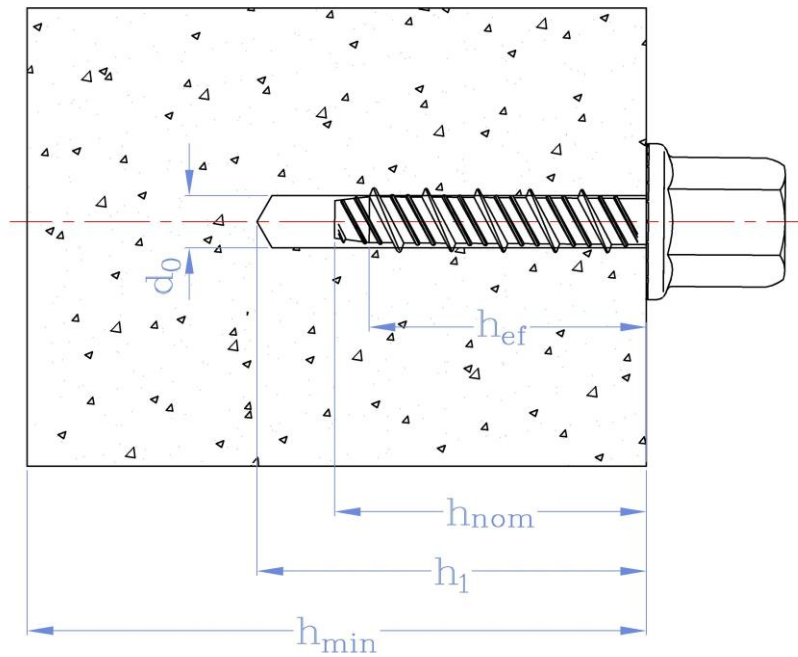English translation prepared by IETcc



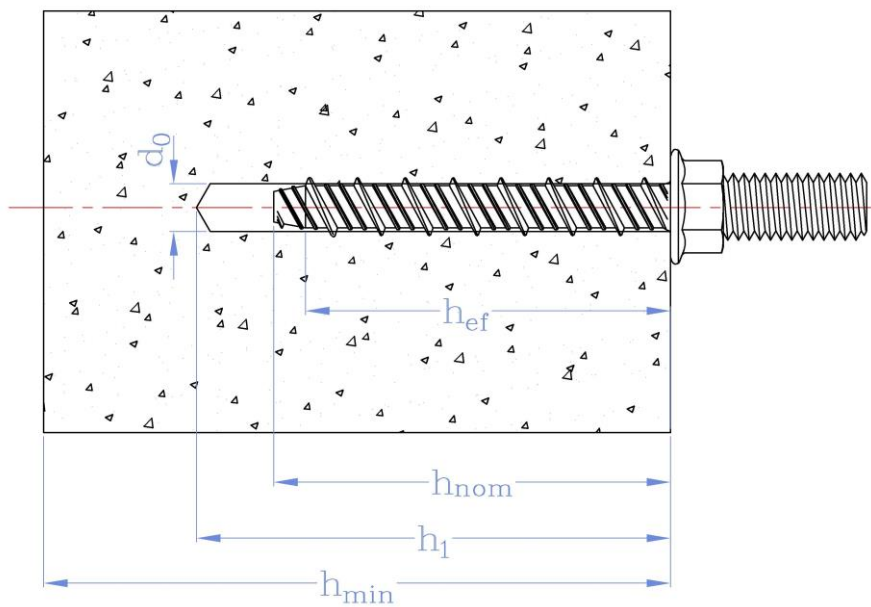**Drawing A2.** Installed condition for anchors SSD, SSI, SSF, SSO, SSU, SSG, SSQ and SSV



**Drawing A3.** Installed condition for anchors SSD, SSI, SSF, SSO, SSU, SSG, SSQ and SSV

|                            |                 |
|----------------------------|-----------------|
| <b>ADBS concrete screw</b> | <b>Annex A5</b> |
| <b>Product description</b> |                 |
| Installed condition        |                 |

### **Intended use**

#### **Anchorage subjected to:**

- Static or quasi static loads: all sizes and embedment depths.

#### **Base materials:**

- Reinforced and unreinforced concrete according to EN 206-1.
- Strength classes C20/25 to C50/60 according to EN 206-1.
- Cracked and uncracked concrete.

#### **Use conditions (environmental conditions):**

- The anchor shall be used in dry internal conditions.
- The anchor may be used for anchorages with requirements related to resistance to fire.

#### **Design:**

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete.
- Verifiable calculation rules and drawings are prepared taking into account of the loads to be attached. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.)
- Anchorages under static or quasi-static loads are designed for design Method A in accordance with:
  - EN 1992-4:2018


#### **Installation:**

- Hammer drilling only.
- Anchor installation carried out by appropriately qualified personal and under the supervision of the person responsible for technical matters of the site.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of aborted hole or smaller distance if the aborted hole is filled with high strength mortar and if under shear or oblique tension load it is not the direction of the load application.
- After installation further turning of the anchor is not possible. The head of the anchor is supported on the fixture, as it is shown in Drawing B1, and it is not damaged.

|                            |                 |
|----------------------------|-----------------|
| <b>ADBS concrete screw</b> | <b>Annex B1</b> |
| <b>Intended use</b>        |                 |
| Specifications             |                 |


**Table B1: Installation parameters**
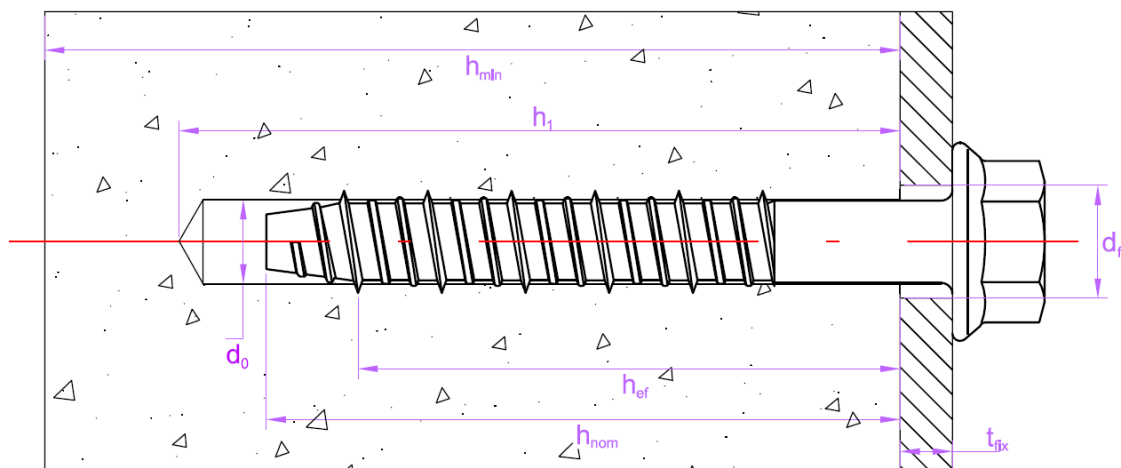
| Installation parameters |   |      | Performance |         |         |         |
|-------------------------|---|------|-------------|---------|---------|---------|
|                         |   |      | SS 7.5      | SS 10.5 | SS 12.5 | SS 16.5 |
| $d_0$                   | Nominal diameter of drill bit:                  | [mm] | 6           | 8       | 10      | 14      |
| $d_f$                   | Diameter of clearance hole in fixture:          | [mm] | 9           | 12      | 14      | 18      |
| $d_s$                   | Outer diameter of the thread                    | [mm] | 7.5         | 10.5    | 12.5    | 16.5    |
| $L_{min}$               | Total length of the anchor                      | [mm] | 60          | 65      | 75      | 115     |
| $L_{max}$               |   | [mm] | 400         | 400     | 400     | 400     |
| $h_{min}$               | Minimum thickness of concrete member:           | [mm] | 100         | 100     | 105     | 175     |
| $h_1$                   | Depth of drilled hole:                          | [mm] | 65          | 70      | 85      | 130     |
| $h_{nom}$               | Overall anchor embedment depth in the concrete: | [mm] | 55          | 60      | 70      | 110     |
| $h_{ef}$                | Effective anchorage depth:                      | [mm] | 42          | 45      | 52      | 86      |
| $T_{ins}$               | Installation torque                             | [Nm] | 20          | 50      | 80      | 120     |
| $t_{fix}$               | Thickness of fixture                            | [mm] | L-55        | L-60    | L-70    | L-110   |
| $s_{min}$               | Minimum allowable spacing:                      | [mm] | 45          | 50      | 60      | 100     |
| $c_{min}$               | Minimum allowable edge distance:                | [mm] | 45          | 50      | 60      | 100     |



**Drawing B1.** Installed condition for anchors SSW, SSR, SSP, SSK, SSH, SSX, SST and SSN

**Installation process**

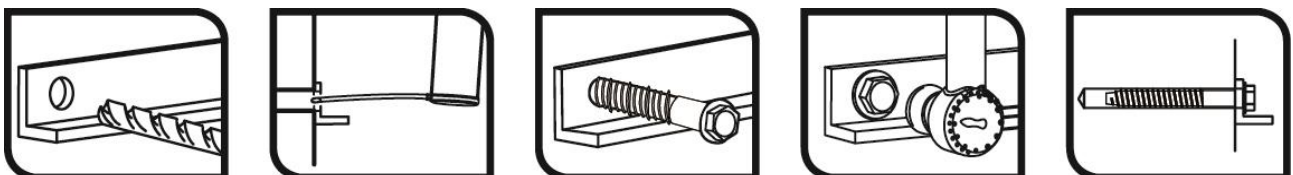

Anchor shall be installed using a torque wrench or an electrical impact driver; power input: 500 W; torque: 50-250 Nm. (e.g: Bosch GDS 18E)

**ADBS concrete screw**

**Performances**

Installation parameters and installation procedure

**Annex B2**

**Table C1: Characteristic values to tension loads of design method A**

| Characteristic values of resistance to tension loads of design method A |   |      | Performance |         |         |         |
|---|---|------|-------------|---------|---------|---------|
|   |   |      | SS 7.5      | SS 10.5 | SS 12.5 | SS 16.5 |
| <b>Tension loads: steel failure</b>                                     |   |      |             |         |         |         |
| $N_{Rk,s}$  | Tension steel characteristic resistance:                        | [kN] | 18.7        | 32.7    | 51.2    | 115.9   |
| $\gamma_{Ms}$   | Partial safety factor:*)  | [-]  | 1.5         | 1.5     | 1.5     | 1.5     |
| <b>Tension loads: pull-out failure in concrete</b>                      |   |      |             |         |         |         |
| $N_{Rk,p,ucr}$  | Tension characteristic resistance in C20/25 uncracked concrete: | [kN] | 9           | 12      | 20      | 40      |
| $\psi_{c,ucr}$  | C30/37  | [-]  | 1.22        | 1.09    | 1.06    | 1.04    |
| $\psi_{c,ucr}$  | C40/45  | [-]  | 1.41        | 1.07    | 1.10    | 1.06    |
| $\psi_{c,ucr}$  | C50/60  | [-]  | 1.58        | 1.22    | 1.13    | 1.08    |
| $N_{Rk,p,cr}$   | Tension characteristic resistance in C20/25 cracked concrete:   | [kN] | 6           | 9       | 12      | 30      |
| $\psi_{c,cr}$   | C30/37  | [-]  | 1.22        | 1.09    | 1.06    | 1.04    |
| $\psi_{c,cr}$   | C40/45  | [-]  | 1.41        | 1.07    | 1.10    | 1.06    |
| $\psi_{c,cr}$   | C50/60  | [-]  | 1.58        | 1.22    | 1.13    | 1.08    |
| $\gamma_{inst}$   | Installation safety factor:*)                                   | [-]  | 1.2         | 1.2     | 1.2     | 1       |
| <b>Tension loads: concrete cone and splitting failure</b>               |   |      |             |         |         |         |
| $h_{ef}$  | Effective embedment depth:                                      | [mm] | 42          | 45      | 52      | 86      |
| $\gamma_{ins}$  | Installation safety factor: *)                                  | [-]  | 1.2         | 1.2     | 1.2     | 1       |
| $s_{cr,N}$  | Critical spacing:   | [mm] | 126         | 135     | 156     | 258     |
| $c_{cr,N}$  | Critical edge distance:   | [mm] | 63          | 67      | 78      | 129     |
| $s_{cr,sp}$   | Critical spacing (splitting):                                   | [mm] | 126         | 135     | 177     | 292     |
| $c_{cr,sp}$   | Critical edge distance (splitting):                             | [mm] | 63          | 67      | 88      | 146     |

\*) In absence of other national regulations

**Table C2: Displacements under tension loads for ADBS concrete screw**

| Displacements under tension loads in uncracked concrete |  |      | Performance |         |         |         |
|---|--|------|-------------|---------|---------|---------|
|   |  |      | SS 7.5      | SS 10.5 | SS 12.5 | SS 16.5 |
| $N$   | Service tension load in uncracked concrete C20/25 to C50/60: | [kN] | 3.6         | 4.8     | 9.5     | 19.0    |
| $\delta_{N0}$   | Short term displacement under tension loads:                 | [mm] | 0.4         | 0.4     | 0.4     | 0.9     |
| $\delta_{N\infty}$                                      | Long term displacement under tension loads:                  | [mm] | 1.0         | 1.1     | 1.4     | 1.4     |
| Displacements under tension loads in cracked concrete   |  |      | Performance |         |         |         |
|   |  |      | SS 7.5      | SS 10.5 | SS 12.5 | SS 16.5 |
| $N$   | Service tension load in cracked concrete C20/25 to C50/60:   | [kN] | 2.4         | 3.6     | 5.7     | 11.9    |
| $\delta_{N0}$   | Short term displacement under tension loads:                 | [mm] | 0.6         | 0.7     | 0.5     | 0.6     |
| $\delta_{N\infty}$                                      | Long term displacement under tension loads:                  | [mm] | 1.4         | 1.2     | 1.4     | 1.2     |

**ADBS concrete screw**

**Performances**

Characteristic values for tension loads  
Displacement under tension loads

**Annex C1**

**Table C3: Characteristic values to shear loads of design method A**

| Characteristic values of resistance to shear loads of design method A |   | Performance |         |         |         |
|---|---|-------------|---------|---------|---------|
|   |   | SS 7.5      | SS 10.5 | SS 12.5 | SS 16.5 |
| <b>Shear loads: steel failure without lever arm</b>                   |   |             |         |         |         |
| $V_{Rk,s}$  | Shear steel characteristic resistance: [kN]       | 7.5         | 16.3    | 35.6    | 57.9    |
| $\gamma_{Ms}$   | Partial safety factor: *)                         | 1.25        | 1.25    | 1.25    | 1.25    |
| <b>Shear loads: steel failure with lever arm</b>                      |   |             |         |         |         |
| $M^0_{Rk,s}$  | Characteristic bending moment: [Nm]               | 15.2        | 35.3    | 69.3    | 235.9   |
| $\gamma_{Ms}$   | Partial safety factor: *)                         | 1.25        | 1.25    | 1.25    | 1.25    |
| <b>Shear loads: concrete pryout failure</b>                           |   |             |         |         |         |
| K   | K factor: [-]                                     | 1           | 1       | 1       | 2       |
| $\gamma_{inst}$   | Installation safety factor: *)                    | 1           | 1       | 1       | 1       |
| <b>Shear loads: concrete edge failure</b>                             |   |             |         |         |         |
| $l_f$   | Effective anchorage depth under shear loads: [mm] | 42          | 45      | 52      | 86      |
| $d_{nom}$   | Outside anchor diameter: [mm]                     | 7.5         | 10.5    | 12.5    | 16.5    |
| $\gamma_{inst}$   | Installation safety factor: *)                    | 1           | 1       | 1       | 1       |

\*) In absence of other national regulations

**Table C4: Displacements under shear loads**

| Displacements under shear loads |   | Performances |         |         |         |
|---------------------------------|---|--------------|---------|---------|---------|
|                                 |   | SS 7.5       | SS 10.5 | SS 12.5 | SS 16.5 |
| V                               | Service shear load in cracked and uncracked concrete C20/25 to C50/60: [kN] | 3.0          | 6.5     | 12.2    | 27.6    |
| $\bar{\delta}_{V0}$             | Short term displacement under shear loads: [mm]                             | 1.3          | 1.4     | 1.8     | 2.3     |
| $\bar{\delta}_{V\infty}$        | Long term displacement under shear loads: [mm]                              | 2.0          | 2.1     | 2.7     | 3.5     |

**Information for design of anchorages under shear loads:**

In general the conditions given in EN 1992-4:2018 are not fulfilled because the diameter of the clearance hole in the fixture (see "Installation parameters" table B1) is greater than the values given in table 6.1 for the corresponding diameter of the anchor. For anchors groups with  $n > 1$  the characteristic load resistance  $V^g_{Rk,s}$  should be limited to  $\max 2 V_{Rk,s}$

However for each specific anchor length the manufacturer may specify the thickness of fixture for which these conditions are fulfilled.

|   |                 |
|---|-----------------|
| <b>ADBS concrete screw</b>  | <b>Annex C2</b> |
| <b>Performances</b><br>Characteristic values for shear loads<br>Displacements under shear loads |                 |

English translation prepared by IETcc

**Table D1: Characteristic values to fire resistance**

| Fire resistance duration = 30 minutes              |   | SS 7.5 | SS 10.5 | SS 12.5 | SS 16.5 |
|--|---|--------|---------|---------|---------|
| <b>Tension loads, steel failure</b>                |   |        |         |         |         |
| $N_{Rk,s,fi,30}$                                   | Characteristic resistance [kN]                          | 0.23   | 0.61    | 1.28    | 2.90    |
| <b>Pull-out failure</b>                            |   |        |         |         |         |
| $N_{Rk,p,fi,30}$                                   | Character. resistance in concrete C20/25 to C50/60 [kN] | 1.50   | 2.25    | 3.00    | 7.50    |
| <b>Concrete cone failure **)</b>                   |   |        |         |         |         |
| $N_{Rk,c,fi,30}$                                   | Character. resistance in concrete C20/25 to C50/60 [kN] | 2.06   | 2.45    | 3.51    | 12.35   |
| <b>Shear loads steel failure without lever arm</b> |   |        |         |         |         |
| $V_{Rk,s,fi,30}$                                   | Characteristic resistance [kN]                          | 0.23   | 0.61    | 1.28    | 2.90    |
| <b>Shear loads, steel failure with lever arm</b>   |   |        |         |         |         |
| $M_{Rk,s,fi,60}$                                   | Characteristic bending resistance [Nm]                  | 0.19   | 0.66    | 1.73    | 5.90    |

| Fire resistance duration = 60 minutes               |   | SS 7.5 | SS 10.5 | SS 12.5 | SS 16.5 |
|---|---|--------|---------|---------|---------|
| <b>Tension loads, steel failure</b>                 |   |        |         |         |         |
| $N_{Rk,s,fi,60}$                                    | Characteristic resistance [kN]                          | 0.21   | 0.53    | 0.96    | 2.17    |
| <b>Pull-out failure</b>                             |   |        |         |         |         |
| $N_{Rk,p,fi,60}$                                    | Character. resistance in concrete C20/25 to C50/60 [kN] | 1.50   | 2.25    | 3.00    | 7.50    |
| <b>Concrete cone failure **)</b>                    |   |        |         |         |         |
| $N_{Rk,c,fi,60}$                                    | Character. resistance in concrete C20/25 to C50/60 [kN] | 2.06   | 2.45    | 3.51    | 12.35   |
| <b>Shear loads, steel failure without lever arm</b> |   |        |         |         |         |
| $V_{Rk,s,fi,60}$                                    | Characteristic resistance [kN]                          | 0.21   | 0.53    | 0.96    | 2.17    |
| <b>Shear loads, steel failure with lever arm</b>    |   |        |         |         |         |
| $M_{Rk,s,fi,60}$                                    | Characteristic bending resistance [Nm]                  | 0.17   | 0.57    | 1.30    | 4.42    |

| Fire resistance duration = 90 minutes               |   | SS 7.5 | SS 10.5 | SS 12.5 | SS 16.5 |
|---|---|--------|---------|---------|---------|
| <b>Tension loads, steel failure</b>                 |   |        |         |         |         |
| $N_{Rk,s,fi,90}$                                    | Characteristic resistance [kN]                          | 0.16   | 0.41    | 0.83    | 1.88    |
| <b>Pull-out failure</b>                             |   |        |         |         |         |
| $N_{Rk,p,fi,90}$                                    | Character. resistance in concrete C20/25 to C50/60 [kN] | 1.50   | 2.25    | 3.00    | 7.50    |
| <b>Concrete cone failure **)</b>                    |   |        |         |         |         |
| $N_{Rk,c,fi,90}$                                    | Character. resistance in concrete C20/25 to C50/60 [kN] | 2.06   | 2.45    | 3.51    | 12.35   |
| <b>Shear loads, steel failure without lever arm</b> |   |        |         |         |         |
| $V_{Rk,s,fi,90}$                                    | Characteristic resistance [kN]                          | 0.16   | 0.41    | 0.83    | 1.88    |
| <b>Shear loads, steel failure with lever arm</b>    |   |        |         |         |         |
| $M_{Rk,s,fi,90}$                                    | Characteristic bending resistance [Nm]                  | 0.13   | 0.44    | 1.13    | 3.83    |

**ADBS concrete screw**

**Performances**  
Characteristic values for fire resistance

**Annex D1**

English translation prepared by IETcc

| Fire resistance duration = 120 minutes              |   | SS 7.5 | SS 10.5 | SS 12.5 | SS 16.5 |
|---|---|--------|---------|---------|---------|
| <b>Tension loads, steel failure</b>                 |   |        |         |         |         |
| $N_{Rk,s,fi,120}$                                   | Characteristic resistance [kN]                          | 0.12   | 0.33    | 0.64    | 1.45    |
| <b>Pull-out failure</b>                             |   |        |         |         |         |
| $N_{Rk,c,fi,120}$                                   | Character. resistance in concrete C20/25 to C50/60 [kN] | 1,20   | 1.80    | 2.40    | 6.00    |
| <b>Concrete cone failure **)</b>                    |   |        |         |         |         |
| $N_{Rk,c,fi,120}$                                   | Character. resistance in concrete C20/25 to C50/60 [kN] | 1.65   | 1.96    | 2.81    | 9.88    |
| <b>Shear loads, steel failure without lever arm</b> |   |        |         |         |         |
| $V_{Rk,s,fi,120}$                                   | Characteristic resistance [kN]                          | 0.12   | 0.33    | 0.64    | 1.45    |
| <b>Shear loads, steel failure with lever arm</b>    |   |        |         |         |         |
| $M_{Rk,s,fi,120}$                                   | Characteristic bending resistance [Nm]                  | 0.10   | 0.35    | 0.87    | 2.95    |

| Spacing and edge distances |   | SS 7.5 | SS 10.5 | SS 12.5 | SS 16.5 |
|----------------------------|---|--------|---------|---------|---------|
| $S_{cr,N}$                 | Spacing [mm]                                | 168    | 180     | 208     | 344     |
| $S_{min}$                  | Minimum spacing [mm]                        | 45     | 50      | 60      | 100     |
| $C_{cr,N}$                 | Edge distance [mm]                          | 84     | 90      | 104     | 172     |
| $C_{min}$                  | Minimum edge distance (one side fire) [mm]  | 84     | 90      | 104     | 172     |
| $C_{min}$                  | Minimum edge distance (two sides fire) [mm] | 300    | 300     | 300     | 300     |
| $\gamma_{Msp}$             | Partial safety factor <sup>*)</sup> [-]     | 1.0    | 1.0     | 1.0     | 1.0     |

\*) In absence of other national regulations

\*\*) As a rule, splitting failure can be neglected when cracked concrete and reinforcement is assumed.

| Concrete pry-out failure   |     | SS 7.5 | SS 10.5 | SS 12.5 | SS 16.5 |
|--|-----|--------|---------|---------|---------|
| k factor   | [-] | 1      | 1       | 1       | 2       |
| According EN 1992-4:2018, these values of k factor and the relevant values of $N_{Rk,c,fi}$ given in the above tables have to be considered in the design. |     |        |         |         |         |

| Concrete edge failure  |
|--|
| The characteristic resistance $V_{Rk,c,fi}^0$ in C20/25 to C50/60 concrete is determined by:<br>$V_{Rk,c,fi}^0 = 0.25 \times V_{Rk,c}^0 (\leq R90)$ and $V_{Rk,c,fi}^0 = 0.20 \times V_{Rk,c}^0 (R120)$<br>With $V_{Rk,c}^0$ initial value of the characteristic resistance in cracked concrete C20/25 under normal temperature according to EN 1992-4:2018. |

**ADBS anchor**

**Performances**  
Characteristic values for fire resistance

**Annex D2**