



**INSTITUTO DE CIENCIAS
DE LA CONSTRUCCIÓN
EDUARDO TORROJA**

C/ Serrano Galvache n. 4 28033 Madrid (Spain)
Tel.: (34) 91 302 04 40 Fax: (34) 91 302 07 00
direccion.ietcc@csic.es <https://dit.ietcc.csic.es>

**European Technical
Assessment**

**ETA 24/0935
of 27/09/2024**

English translation prepared by IETcc. Original version in Spanish language

General Part

**Technical Assessment Body issuing
the ETA designated according to
Art. 29 of Regulation (EU) 305/2011:**

Instituto de Ciencias de la Construcción Eduardo
Torroja (IETcc)

**Trade name of the construction
product:**

**Masonmate Drop In Anchor DWS, DWSL,
DWSS, DWEA4**

**Product family to which the
construction product belongs:**

Deformation controlled anchor made of galvanized
steel or stainless steel of sizes M6, M8, M10, M12,
M16 and M20 for use in concrete for redundant
non-structural systems

Manufacturer:

Dormole Ltd
Long Reach, Galleon Boulevard,
Crossways Business Park
Dartford, Kent, DA2 6QE
website: www.dormole.net

Manufacturing plant:

Dormole plant 1

**This European Technical
Assessment contains:**

15 pages including 3 annexes which form an
integral part of this assessment.

**This European Technical
Assessment is issued in accordance
with regulation (EU) No 305/2011, on
the basis of:**

European Assessment Document EAD 330747-
00-0601, "Fasteners for use in concrete for
redundant non-structural systems", ed. May 2018.

Código seguro de Verificación : GEN-535d-ba2a-a605-528e-d2a9-0c6e-1648-47c6 | Puede verificar la integridad de este documento en la siguiente dirección :
<https://sede.administracion.gob.es/pagSedeFront/servicios/consultaCSV.htm>

CSV : GEN-535d-ba2a-a605-528e-d2a9-0c6e-1648-47c6

DIRECCIÓN DE VALIDACIÓN : <https://sede.administracion.gob.es/pagSedeFront/servicios/consultaCSV.htm>

FIRMANTE(1) : ANGEL CASTILLO TALAVERA | FECHA : 04/10/2024 08:07 | Sin acción específica



English translation prepared by IETcc

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission according to article 25 (3) of Regulation (EU) No 305/2011.

Código seguro de Verificación : GEN-535d-ba2a-a605-528e-d2a9-0c6e-1648-47c6 | Puede verificar la integridad de este documento en la siguiente dirección :
<https://sede.administracion.gob.es/pagSedeFront/servicios/consultaCSV.htm>

CSV : GEN-535d-ba2a-a605-528e-d2a9-0c6e-1648-47c6

DIRECCIÓN DE VALIDACIÓN : <https://sede.administracion.gob.es/pagSedeFront/servicios/consultaCSV.htm>

FIRMANTE(1) : ANGEL CASTILLO TALAVERA | FECHA : 04/10/2024 08:07 | Sin acción específica



SPECIFIC PART

1. Technical description of the product

The Masonmate Drop In Anchor DWS, DWSL, DWSS, in the range of M6 to M20, is an anchor made of galvanised steel. The Masonmate Drop In Anchor DWEA4, in the range of M6 to M20, is an anchor made of stainless steel. They are placed into a drilled hole and anchored by deformation-controlled expansion. The anchorage is characterised by friction between the sleeve and concrete.

Product and installation descriptions are given in annexes A1 and A2.

2. Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a mean to choosing the right products in relation to the expected economically reasonable working life of the works.

3. Performance of the product and references to the methods used for its assessment

3.1 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchorage satisfy requirements for class A1 according to EN 13501-1
Resistance to fire	See annex C7

3.2 Safety in use (BWR 4)

Essential characteristic	Performance
Essential characteristics under static or quasi static loading	See annexes C3 to C6

4. Assessment and Verification of Constancy of Performances (hereinafter AVCP) system applied, with reference to its legal base

The applicable European legal act for the system of Assessment and Verification of Constancy of Performances (see annex V to Regulation (EU) No 305/2011) is 97/161/EC.

The system to be applied is 2+.



5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

The technical details necessary for the implementation of the AVCP system are laid down in the quality plan deposited at Instituto de Ciencias de la Construcción Eduardo Torroja.



Instituto de Ciencias de la Construcción Eduardo Torroja
CONSEJO SUPERIOR DE INVESTIGACIONES CIENTÍFICAS

C/ Serrano Galvache n.º 4. 28033 Madrid.
Tel: (+34) 91 302 04 40 Fax: (+34) 91 302 07 00
<https://dit.ietcc.csic.es>



On behalf of the Instituto de Ciencias de la Construcción Eduardo Torroja
Madrid, 27th of September 2024

Mr. Ángel Castillo Talavera
Director

Código seguro de Verificación : GEN-535d-ba2a-a605-528e-d2a9-0c6e-1648-47c6 | Puede verificar la integridad de este documento en la siguiente dirección :
<https://sede.administracion.gob.es/pagSedeFront/servicios/consultaCSV.htm>



Product



DWS anchor



DWSL anchor



DWEA4 anchor



DWSS anchor

Identification on sleeve: Dormole logo + “DWS (DWSL, DWSS, DWEA4)” + Metric

Table A1: Dimensions

Anchor dimensions	M6	M8	M10	M12	M12D	M16	M20
DWS, DWSL							
ØD: External diameter [mm]	8	10	12	15	16	20	25
Ød: internal diameter [mm]	M6	M8	M10	M12	M12	M16	M20
L: total length [mm]	25	30	40	50	50	65	80
DWSS							
ØD: External diameter [mm]	--	10	12	15	--	--	--
Ød: internal diameter [mm]	--	M8	M10	M12	--	--	--
L: total length [mm]	--	25	25	25	--	--	--
DWEA4							
ØD: External diameter [mm]	8	10	12	15	--	20	25
Ød: internal diameter [mm]	M6	M8	M10	M12	--	M16	M20
L: total length [mm]	25	30	40	50	--	65	80

Table A2: Materials

Item	Designation	Material for DWS, DWSL, DWSS	Material for DWEA4
1	Sleeve	Carbon steel, zinc plated $\geq 5 \mu\text{m}$ ISO 4042 Zn5/An/T0	Stainless steel, grade A4
2	Cone	Carbon steel, zinc plated $\geq 5 \mu\text{m}$ ISO 4042 Zn5/An/T0	Stainless steel, grade A4
3	Retention disc	Plastic	Plastic

DWS, DWSL, DWSS, DWEA4 anchor


Product description

Product and materials

Annex A1



Installed condition in concrete

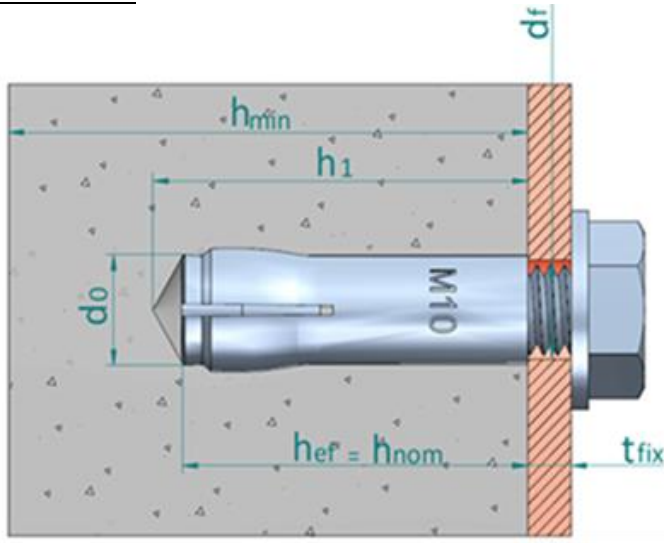

- h_{ef} : Effective anchorage depth
 h_1 : Depth of drilled hole
 h_{nom} : Overall anchor embedment depth in the concrete
 h_{min} : Minimum thickness of concrete member
 t_{fix} : Thickness of fixture
 d_0 : Nominal diameter of drill bit
 d_f : Fixture clearance hole diameter

Setting tool



Setting tool can be assembled with a plastic handle for hand protection purposes

Table A3: Setting tool dimensions

Setting tool dimensions	M6	M8	M10	M12	M16	M20
DWS, DWSL, DWEA4						
Ø D ₁ [mm]	8.0	10.0	12.0	15.0	20.0	25.0
Ø D ₂ [mm]	4.9	6.4	8.2	10.0	13.5	17.0
L _s [mm]	15.0	18.0	21.0	30.0	36.0	48.0
DWSS						
Ø D ₁ [mm]	--	10.0	12.0	15.0	--	--
Ø D ₂ [mm]	--	6.4	8.2	10.0	--	--
L _s [mm]	--	15.0	16.0	10.4	--	--

DWS, DWSL, DWSS, DWEA4 anchor


Product description

Installed condition in concrete and setting tool

Annex A2



Installed condition in precast prestressed hollow core concrete slabs

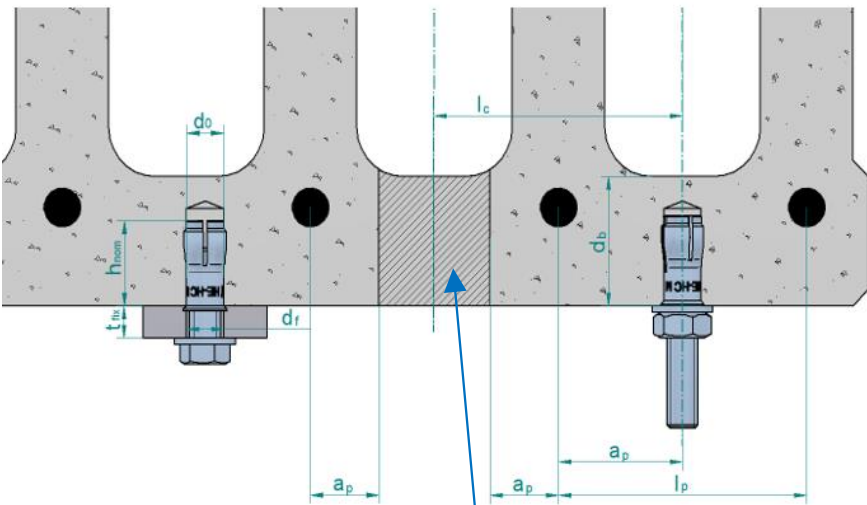

Admisible anchor position

- d₀: Nominal diameter of drill bit
- d_r: Fixture clearance hole diameter
- d_b: Bottom flange thickness
- a_p: Distance between anchor position and prestressing steel ≥ 50 mm
- l_c: Core distance ≥ 100 mm
- l_p: Prestressing steel distance ≥ 100 mm
- t_{fix}: Fixture thickness
- c: Edge distance

DWSS anchor

Product description

Installed condition in precast prestressed hollow core concrete slabs

Annex A3



Specifications of intended use

Anchorage subjected to:

- Static or quasi static loads for redundant non-structural systems.
- Use for anchorages with requirements related to resistance of fire (not for using in prestressed hollow core slabs).
- The anchor may only be used if in the design and installation specifications for the fixture the excessive slip or failure of one anchor will not result in a significant violation of the requirements on the fixture in the serviceability and ultimate state.

Base materials:

- Reinforced or unreinforced normal weight concrete without fibres according to EN 206-1:2013+A1:2016.
- Strength classes C12/15 to C50/60 according to EN 206-1:2013+A1:2016: DWS / DWSL anchors.
- Strength classes C20/25 to C50/60 according to EN 206-1:2013+A1:2016: DWSS / DWEA4 anchors.
- Cracked or uncracked concrete.
- Precast, prestressed hollow core concrete slabs, strength C30/37 to C50/60 according to EN 206:2013+A1:2016: DWSS.

Use conditions (environmental conditions):

- DWS, DWSL, DWSS: anchorages subjected to dry internal conditions.
- DWEA4: anchorages subjected to dry internal conditions, to external atmospheric exposure (including industrial and marine environment) or to permanent internal damp conditions if no particular aggressive conditions exist. Such particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used). Atmospheres under Corrosion Resistance Class CRC III according to EN 1993-1-4:2006+A1:2015 annex A.

Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete.
- Verifiable calculation rules and drawings are prepared taking into account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages under static or quasi-static actions are designed for design method B in accordance with EN 1992-4:2018
- Anchorages under fire exposure are designed in accordance to EN 1992-4:2018. It must be ensured that local spalling of the concrete cover does not occur.

Installation:

- Hole drilling by rotary plus hammer mode.
- Anchor installation carried out by appropriately qualified personal and under the supervision of the person responsible for technical matters of the site.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of aborted hole or smaller distance if the aborted hole is filled with high strength mortar and if under shear or oblique tension load it is not the direction of the load application.
- DWS, DWSL, DWSS: the bolt or threaded rod to be used shall be property class 4.6, 5.6, 5.8, 6.8 or 8.8 according to ISO 898-1.
- DWEA4: the bolt or threaded rod to be used shall be property class A4-50, A4-70 or A4-80 according to EN 3506-1:2009
- The length of the bolt shall be determined as: -Minimum bolt length = $t_{fix} + l_{s,min}$
-Maximum bolt length = $t_{fix} + l_{s,max}$

DWS, DWSL, DWSS, DWEA4 anchor

Intended use

Specifications

Annex B1



Table C1: Installation parameters in concrete for DWS, DWSL, DWSS, DWEA4 anchor

Installation parameters			Performances						
			M6	M8	M10	M12	M12D	M16	M20
d ₀	Nominal diameter of drill bit:	[mm]	8	10	12	15	16	20	25
D	Thread diameter:	[mm]	M6	M8	M10	M12	M12	M16	M20
d _f	Fixture clearance hole diameter ≤	[mm]	7	9	12	14	14	18	22
T _{inst}	Maximum installation torque:	[Nm]	4	11	17	38	38	60	100
DWS, DWSL			DWSM06 DWSLM06	DWSM08 DWSLM08	DWSM10 DWSLM10	DWSM12 DWSLM12	DWSM12D DWSLM12D	DWSM16 DWSLM16	DWSM20 DWSLM20
ℓ _{s,min}	Minimum screwing depth:	[mm]	6	8	10	12	12	16	20
ℓ _{s,max}	Maximum screwing depth:	[mm]	10	13	17	21	21	27	34
h ₁	Depth of drilled hole:	[mm]	27	33	43	54	54	70	86
h _{nom}	Overall anchor embedment depth:	[mm]	25	30	40	50	50	65	80
h _{ef}	Effective anchorage depth:	[mm]	25	30	40	50	50	65	80
h _{min}	Minimum thickness of concrete member:	[mm]	100	100	100	100	100	130	160
S _{min}	Minimum allowable spacing:	[mm]	60	60	80	100	100	130	160
C _{min}	Minimum allowable distance:	[mm]	105	105	140	175	130	230	280
DWSS			:	DWSSM08	DWSSM10	DWSSM12	:	:	:
ℓ _{s,min}	Minimum screwing depth:	[mm]	--	7	8	10	--	--	--
ℓ _{s,max}	Maximum screwing depth:	[mm]	--	12	13	13	--	--	--
h ₁	Depth of drilled hole:	[mm]	--	28	28	29	--	--	--
h _{nom}	Overall anchor embedment depth:	[mm]	--	25	25	25	--	--	--
h _{ef}	Effective anchorage depth:	[mm]	--	25	25	25	--	--	--
h _{min}	Minimum thickness of concrete member:	[mm]	--	80	80	80	--	--	--
S _{min}	Minimum allowable spacing:	[mm]	--	75	75	75	--	--	--
C _{min}	Minimum allowable distance:	[mm]	--	60	60	60	--	--	--
DWEA4			DWEA4M06	DWEA4M08	DWEA4M10	DWEA4M12	--	DWEA4M16	DWEA4M20
ℓ _{s,min}	Minimum screwing depth:	[mm]	6	8	10	12	--	16	20
ℓ _{s,max}	Maximum screwing depth:	[mm]	10	13	17	21	--	27	34
h ₁	Depth of drilled hole:	[mm]	27	33	43	54	--	70	86
h _{nom}	Overall anchor embedment depth:	[mm]	25	30	40	50	--	65	80
h _{ef}	Effective anchorage depth:	[mm]	25	30	40	50	--	65	80
h _{min}	Minimum thickness of concrete member:	[mm]	80	80	80	100	--	130	160
S _{min}	Minimum allowable spacing:	[mm]	60	60	100	100	--	130	160
C _{min}	Minimum allowable distance:	[mm]	65	80	100	130	--	175	210
DWS, DWSL, DWSS, DWEA4 anchor							Annex C1		
Performances									
Installation parameters in concrete									



Table C2: Installation parameters in prestressed hollow core concrete slabs for DWSS anchor


Installation parameters in prestressed hollow core concrete slabs				Performances						
DWSS				:	DWSSM08	DWSSM10	DWSSM12	:	:	:
$\ell_{s,min}$	Minimum screwing depth:	[mm]	--	7	8	10	--	--	--	
$\ell_{s,max}$	Maximum screwing depth:	[mm]	--	12	13	13	--	--	--	
h_1	Depth of drilled hole:	[mm]	--	28	28	29	--	--	--	
h_{nom}	Overall anchor embedment depth:	[mm]	--	25	25	25	--	--	--	
h_{ef}	Effective anchorage depth:	[mm]	--	25	25	25	--	--	--	
d_b	Minimum bottom flange thickness	[mm]	--	35	35	35	--	--	--	
s_{min}	Minimum allowable spacing:	[mm]	--	200	200	200	--	--	--	
c_{min}	Minimum allowable distance:	[mm]	--	150	150	150	--	--	--	

Código seguro de Verificación : GEN-535d-ba2a-a605-528e-d2a9-0c6e-1648-47c6 | Puede verificar la integridad de este documento en la siguiente dirección :
<https://sede.administracion.gob.es/pagSedeFront/servicios/consultaCSV.htm>



English translation prepared by IETcc

Installation process

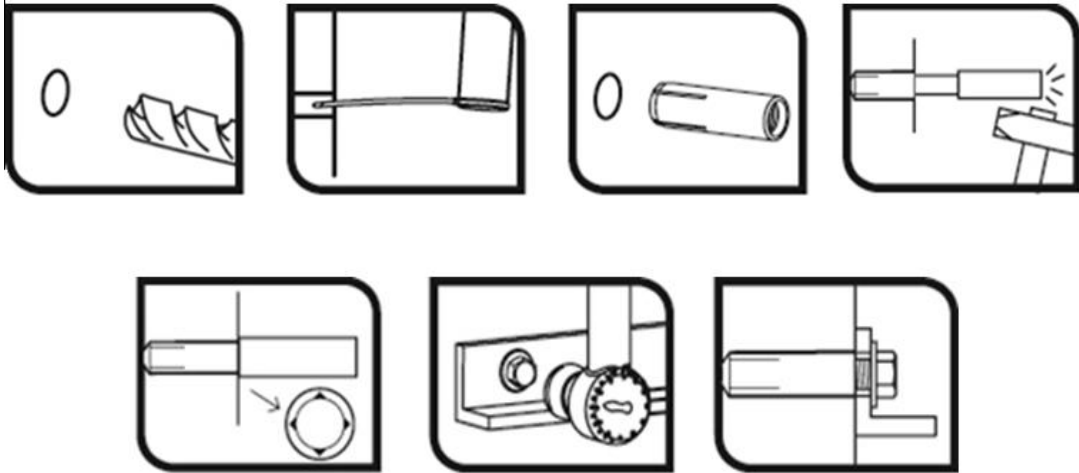

DWS, DWSL, DWSS, DWEA4 anchor

Performances

Installation procedure

Annex C3



Table C3: Essential characteristics in concrete to loads of design method B according to EN 1992-4 for DWS, DWSL, DWSS anchor

Essential characteristics of resistance to loads of design method B			Performances						
			M6	M8	M10	M12	M12D	M16	M20
Any load direction									
DWS, DWSL									
F_{Rk}^0	Characteristic resistance in C12/15 concrete:	[kN]	1.5	3.0	4.0	6.0	--	9.0	16.0
F_{Rk}^0	Characteristic resistance in C20/25 to C50/60 concrete:	[kN]	2.0	3.0	5.0	7.5	6.0	12.0	20.0
γ_{ins}	Installation safety factor:	[-]	1.2	1.2	1.4	1.4	1.4	1.4	1.4
S_{cr}	Critical spacing:	[mm]	75	90	120	150	200	195	240
C_{cr}	Critical edge distance:	[mm]	40	45	60	75	150	100	120
DWSS									
F_{Rk}^0	Characteristic resistance in C20/25 to C50/60 concrete:	[kN]	--	2.5	4.0	4.0	--	--	--
γ_{ins}	Installation safety factor:	[-]	--	1.2	1.2	1.2	--	--	--
S_{cr}	Critical spacing:	[mm]	--	120	120	120	--	--	--
C_{cr}	Critical edge distance:	[mm]	--	60	60	60	--	--	--
Shear loads: steel failure with lever arm									
$M_{Rk,s}^0$	Characteristic bending moment, steel class 4.6	[Nm]	6.1	15.0	29.9	52.4	52.4	133.3	259.8
$\gamma_{Ms}^{1)}$	Partial safety factor:	[-]	1.67						
$M_{Rk,s}^0$	Characteristic bending moment, steel class 4.8	[Nm]	6.1	15.0	29.9	52.4	52.4	133.3	259.8
$\gamma_{Ms}^{1)}$	Partial safety factor:	[-]	1.25						
$M_{Rk,s}^0$	Characteristic bending moment, steel class 5.6	[Nm]	7.6	18.8	37.4	65.5	65.5	166.6	324.8
$\gamma_{Ms}^{1)}$	Partial safety factor:	[-]	1.67						
$M_{Rk,s}^0$	Characteristic bending moment, steel class 5.8	[Nm]	7.6	18.8	37.4	65.5	65.5	166.6	324.8
$\gamma_{Ms}^{1)}$	Partial safety factor:	[-]	1.25						
$M_{Rk,s}^0$	Characteristic bending moment, steel class 6.8	[Nm]	9.2	22.5	44.9	78.7	78.7	199.9	389.7
$\gamma_{Ms}^{1)}$	Partial safety factor:	[-]	1.25						
$M_{Rk,s}^0$	Characteristic bending moment, steel class 8.8	[Nm]	12.2	30.0	59.9	104.9	104.9	266.6	519.7
$\gamma_{Ms}^{1)}$	Partial safety factor:	[-]	1.25						

1) In absence of other national regulations

DWS, DWSL, DWSS anchor

Performances

Essential characteristics in concrete

Annex C4



English translation prepared by IETcc

Table C4: Essential characteristics in concrete to loads of design method B according to EN 1992-4 for DWEA4 anchor

Essential characteristic of resistance to loads of design method B		Performances					
		M6	M8	M10	M12	M16	M20
All load direction							
F_{Rk}^0	Characteristic resistance in C20/25 to C50/60 concrete: [kN]	2.5	3.5	3.5	6.5	12.5	16.5
γ_{ins}	Installation safety factor: [-]	1.4					
S_{cr}	Critical spacing: [mm]	200	200	200	200	260	320
C_{cr}	Critical edge distance: [mm]	150	150	150	150	195	240
Shear loads: steel failure with lever arm							
$M_{Rk,s}^0$	Characteristic bending moment, steel class A4-50 [Nm]	7.6	18.8	37.4	65.6	166.6	324.8
$\gamma_{Ms}^{(1)}$	Partial safety factor: [-]	2.38					
$M_{Rk,s}^0$	Characteristic bending moment, steel class A4-70 [Nm]	10.6	26.3	52.4	91.8	233.1	454.7
$\gamma_{Ms}^{(1)}$	Partial safety factor: [-]	1.56					
$M_{Rk,s}^0$	Characteristic bending moment, steel class A4-80 [Nm]	12.2	30.0	59.9	104.9	266.6	519.7
$\gamma_{Ms}^{(1)}$	Partial safety factor: [-]	1.34					

1) In absence of other national regulations

DWEA4 anchor

Performances

Essential characteristic in concrete

Annex C5

Código seguro de Verificación : GEN-535d-ba2a-a605-528e-d2a9-0c6e-1648-47c6 | Puede verificar la integridad de este documento en la siguiente dirección : <https://sede.administracion.gob.es/pagSedeFront/servicios/consultaCSV.htm>

CSV : GEN-535d-ba2a-a605-528e-d2a9-0c6e-1648-47c6

DIRECCIÓN DE VALIDACIÓN : <https://sede.administracion.gob.es/pagSedeFront/servicios/consultaCSV.htm>

FIRMANTE(1) : ANGEL CASTILLO TALAVERA | FECHA : 04/10/2024 08:07 | Sin acción específica



Table C5: Essential characteristics in precast prestressed hollow core slabs to loads of design method B according to EN 1992-4 for DWSS anchor

Essential characteristics of resistance to loads of design method B		Performances						
		M6	M8	M10	M12	M12D	M16	M20
Any load direction								
DWSS								
F_{Rk}^0	Characteristic resistance in prestressed hollow core concrete slabs C30/37 to C50/60: [kN]	--	5,5	6,0	6,5	--	--	--
γ_{ins}	Installation safety factor: [-]	--	1.2	1.4	1.4	--	--	--
S_{cr}	Critical spacing: [mm]	--	200	200	200	--	--	--
C_{cr}	Critical edge distance: [mm]	--	150	150	150	--	--	--
Shear loads: steel failure with lever arm								
$M_{Rk,s}^0$	Characteristic bending moment, steel class 4.6 [Nm]	--	15.0	29.9	52.4	--	--	--
$\gamma_{Ms}^{(1)}$	Partial safety factor: [-]	--	1.67			--	--	--
$M_{Rk,s}^0$	Characteristic bending moment, steel class 4.8 [Nm]	--	15.0	29.9	52.4	--	--	--
$\gamma_{Ms}^{(1)}$	Partial safety factor: [-]	--	1.25			--	--	--
$M_{Rk,s}^0$	Characteristic bending moment, steel class 5.6 [Nm]	--	18.8	37.4	65.5	--	--	--
$\gamma_{Ms}^{(1)}$	Partial safety factor: [-]	--	1.67			--	--	--
$M_{Rk,s}^0$	Characteristic bending moment, steel class 5.8 [Nm]	--	18.8	37.4	65.5	--	--	--
$\gamma_{Ms}^{(1)}$	Partial safety factor: [-]	--	1.25			--	--	--
$M_{Rk,s}^0$	Characteristic bending moment, steel class 6.8 [Nm]	--	22.5	44.9	78.7	--	--	--
$\gamma_{Ms}^{(1)}$	Partial safety factor: [-]	--	1.25			--	--	--
$M_{Rk,s}^0$	Characteristic bending moment, steel class 8.8 [Nm]	--	30.0	59.9	104.9	--	--	--
$\gamma_{Ms}^{(1)}$	Partial safety factor: [-]	--	1.25			--	--	--

1) In absence of other national regulations

DWSS anchor

Performances

Essential characteristics in precast prestressed hollow core concrete slabs

Annex C6

Código seguro de Verificación : GEN-535d-ba2a-a605-528e-d2a9-0c6e-1648-47c6 | Puede verificar la integridad de este documento en la siguiente dirección : <https://sede.administracion.gob.es/pagSedeFront/servicios/consultaCSV.htm>



Table C6: Essential characteristics under fire exposure in concrete C20/25 to C50/50 in any load direction according to EN 1992-4 for DWS, DWSL anchor

Essential characteristics under fire exposure in concrete C20/25 to C50/60 in any load direction				Performances						
				M6	M8	M10	M12	M12D	M16	M20
R30	Characteristic resistance:	$F_{Rk,fi30}^{0\ 1)}$	[kN]	0.2	0.4	0.9	1.7	1,7	3.1	4.9
R60	Characteristic resistance:	$F_{Rk,fi60}^{0\ 1)}$	[kN]	0.2	0.3	0.8	1.3	1,3	2.4	3.7
R90	Characteristic resistance:	$F_{Rk,fi90}^{0\ 1)}$	[kN]	0.1	0.3	0.6	1.1	1,1	2.0	3.2
R120	Characteristic resistance:	$F_{Rk,fi120}^{0\ 1)}$	[kN]	0.1	0.2	0.5	0.8	0,8	1.6	2.5
R30 to	Spacing	$S_{cr,fi}$	[mm]	4 x h_{ef}						
R120	Edge distance	$C_{cr,fi}$	[mm]	2 x h_{ef}						

¹⁾ in absence of other national regulations the partial safety factor for resistance under fire exposure $\gamma_{M,fi}$ =1.0 is recommended
If fire attack is from more than one side, the design method may be taken if edge distance of the anchor is $c \geq 300$ mm

Table C7: Essential characteristics under fire exposure in concrete C20/25 to C50/50 in any load direction according to EN 1992-4 for DWSS anchor

Essential characteristics under fire exposure in concrete C20/25 to C50/60 in any load direction				Performances					
				M6	M8	M10	M12	M16	M20
R30	Characteristic resistance:	$F_{Rk,fi30}^{0\ 1)}$	[kN]	--	0.54	0.54	0.54	--	--
R60	Characteristic resistance:	$F_{Rk,fi60}^{0\ 1)}$	[kN]	--	0.54	0.54	0.54	--	--
R90	Characteristic resistance:	$F_{Rk,fi90}^{0\ 1)}$	[kN]	--	0.44	0.54	0.54	--	--
R120	Characteristic resistance:	$F_{Rk,fi120}^{0\ 1)}$	[kN]	--	0.37	0.43	0.43	--	--
R30 to	Spacing	$S_{cr,fi}$	[mm]	--	4 x h_{ef}			--	--
R120	Edge distance	$C_{cr,fi}$	[mm]	--	2 x h_{ef}			--	--

¹⁾ in absence of other national regulations the partial safety factor for resistance under fire exposure $\gamma_{M,fi}$ =1.0 is recommended
If fire attack is from more than one side, the design method may be taken if edge distance of the anchor is $c \geq 300$ mm

Table C8: Essential characteristics under fire exposure in concrete C20/25 to C50/50 in any load direction according to EN 1992-4 for DWEA4 anchor

Essential characteristics under fire exposure in concrete C20/25 to C50/60 in any load direction				Performances					
				M6	M8	M10	M12	M16	M20
R30	Characteristic resistance:	$F_{Rk,fi30}^{0\ 1)}$	[kN]	0.20	0.73	0.87	1.63	3.19	4.12
R60	Characteristic resistance:	$F_{Rk,fi60}^{0\ 1)}$	[kN]	0.18	0.59	0.87	1.63	3.19	4.12
R90	Characteristic resistance:	$F_{Rk,fi90}^{0\ 1)}$	[kN]	0.14	0.44	0.87	1.63	3.14	4.12
R120	Characteristic resistance:	$F_{Rk,fi120}^{0\ 1)}$	[kN]	0.10	0.37	0.69	1.30	2.51	3.30
R30 to	Spacing	$S_{cr,fi}$	[mm]	4 x h_{ef}					
R120	Edge distance	$C_{cr,fi}$	[mm]	2 x h_{ef}					

¹⁾ in absence of other national regulations the partial safety factor for resistance under fire exposure $\gamma_{M,fi}$ =1.0 is recommended
If fire attack is from more than one side, the design method may be taken if edge distance of the anchor is $c \geq 300$ mm

DWS, DWSL, DWSS, DWEA4 anchor

Performances

Essential characteristics under fire exposure

Annex C7

